


CONFORMING TO ASTM C-923
STUB OUTS TO BE A MINIMUM
OF ONE JOINT LENGTH FOR
FLEXIBLE PIPE

COUPLING WITH O-RING
RUBBER GASKET

PLAN OF TYPE "C"
(COVER NOT SHOWN)

NOTE:

1. ALL PRECAST SECTIONS SHALL CONFORM TO THE REQUIREMENTS OF ASTM C-478. ALL POURED IN PLACE CONCRETE SHALL HAVE A 28 DAY STRENGTH OF 4000 PSI.
2. CEMENT STABILIZED SAND SHALL BE BROUGHT TO WITHIN TWO FEET OF TOP OF MANHOLE.
3. RUBBER GASKETS JOINTS SHALL CONFORM TO ASTM C478, C443 AND C76.
4. INVERTS AND FLEXIBLE SEAL BOOTS, PER ASTM C923, SHALL BE CAST INTO BASE SECTION FOR FLEXIBLE PIPE CONNECTION. RIGID (CONCRETE) PIPE TO MANHOLE CONNECTION SHALL BE GROUTED.

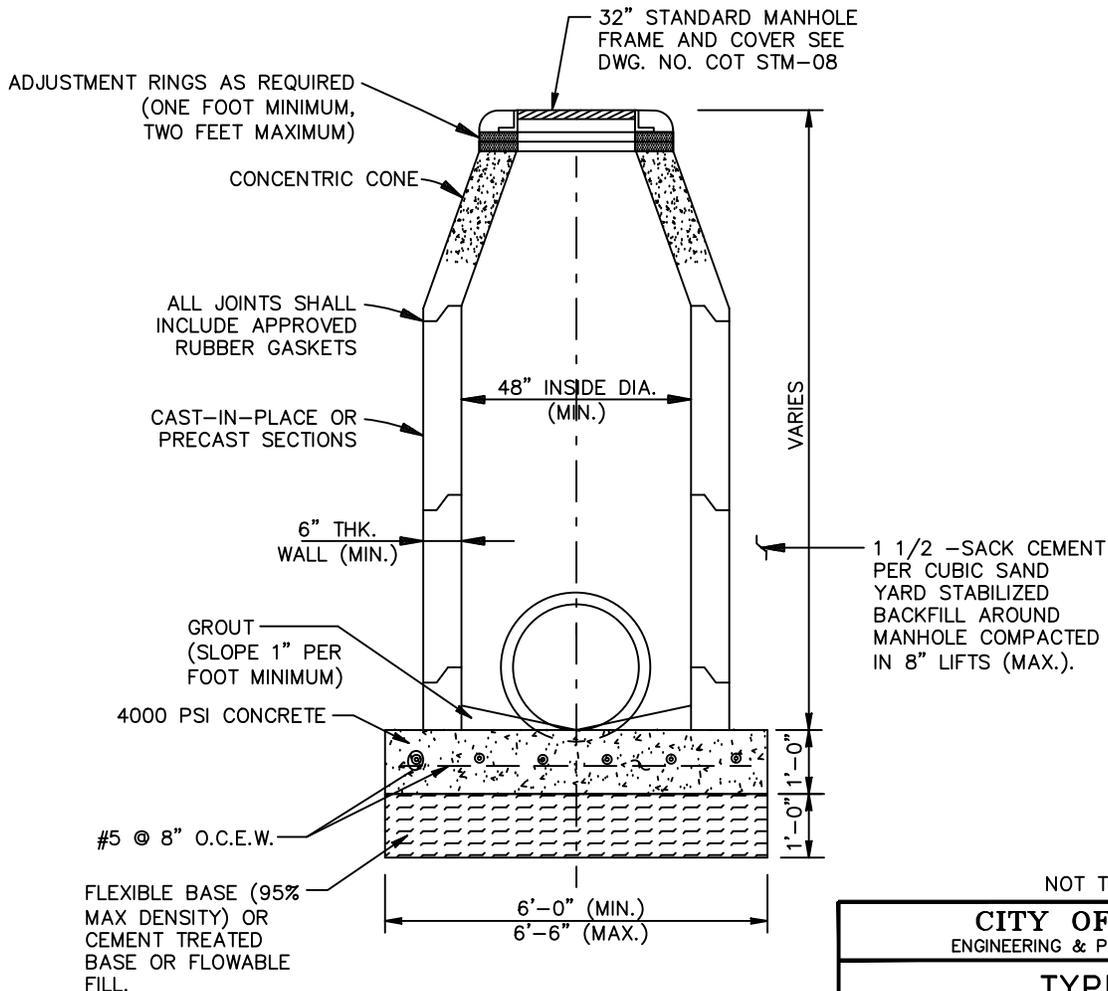

SECTION B-B

NOT TO SCALE

CITY OF TOMBALL ENGINEERING & PLANNING DEPARTMENT	
TYPE "C" STORM SEWER MANHOLE FOR 42" PIPE AND SMALLER	
APPROVED BY COT:	
ENGINEERING & PLANNING DEPARTMENT EFFECTIVE AUGUST, 26 2019	
SHEET 001 OF 001	DWG NO: COT STM-09