


ELEVATION

NOTE:
FOR SMALLER BOX SEWER WIDTHS, WHERE IT IS NOT POSSIBLE TO EXTEND REINFORCING STEEL BEYOND THE OPENING, REINFORCING STEEL SHALL BE EXTENDED 3" TO THE EDGE OF THE WALL.

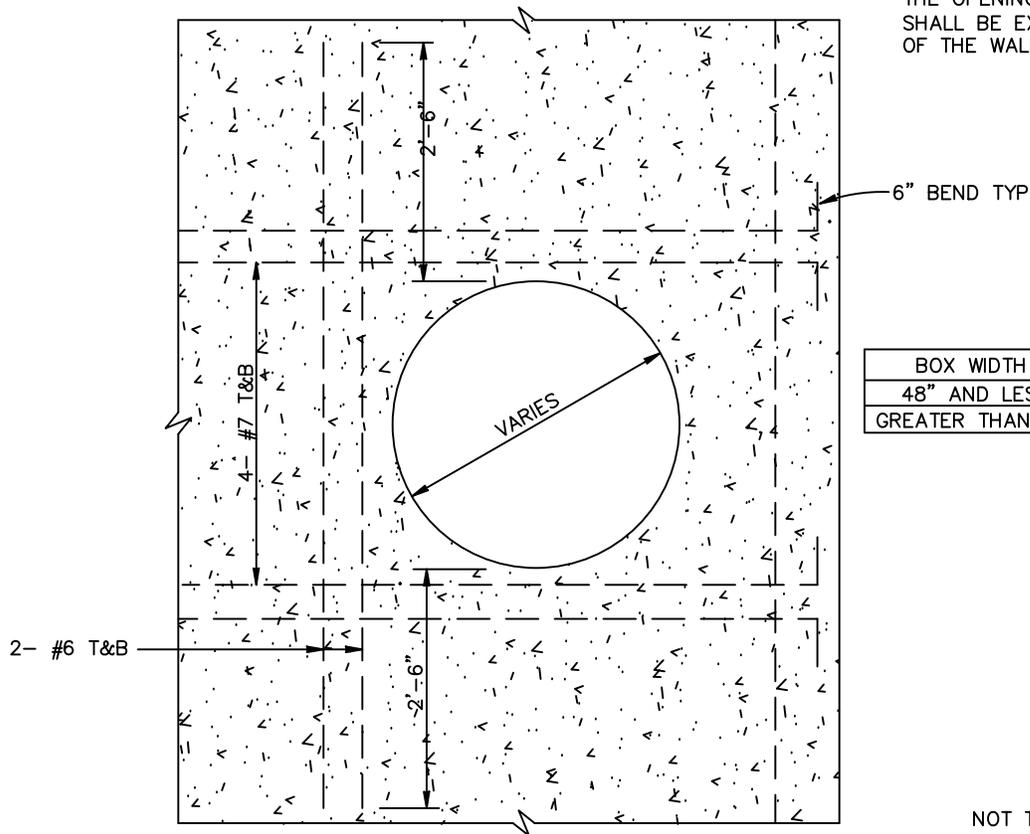

BOX WIDTH	OPENING SIZE
48" AND LESS	36"
GREATER THAN 48"	48"

NOT TO SCALE

SECTION A-A

CITY OF TOMBALL
ENGINEERING & PLANNING DEPARTMENT

MANHOLE FOR PROPOSED
BOX STORM SEWER
CONSTRUCTION DETAILS

APPROVED BY COT:

ENGINEERING & PLANNING DEPARTMENT
EFFECTIVE SEPTEMBER 7, 2017

SHEET 001 OF 001

DWG NO: COT STM-11