



NOTES:

1. A MINIMUM OF 4" ADJUSTMENT RING BE PROVIDED. THE TOTAL HEIGHT OF THE ADJUSTMENT RINGS SHALL NOT EXCEED 12".
2. MANHOLE INTERSECTING PIPES SHALL BE INSTALLED ONLY WHEN CALLED FOR IN PLAN AND PROFILE DRAWING.
3. SEAT MANHOLE FRAME IN SEALANT.
4. OMIT CEMENT MORTAR WHEN MANHOLE IS LOCATED IN PAVED AREAS.
5. MINIMUM REINFORCING IN THE BASE BE # 5 @ 8" O.C.E.W.
6. PROVIDE BACKFILL MATERIAL AS PER COT STANDARD SPECIFICATIONS.
7. INSIDE OF MANHOLE SHALL BE LINED WITH RAVEN LINING 405 EPOXY LINER, OR APPROVED EQUAL WITH 100 MILS MINIMUM THICKNESS.

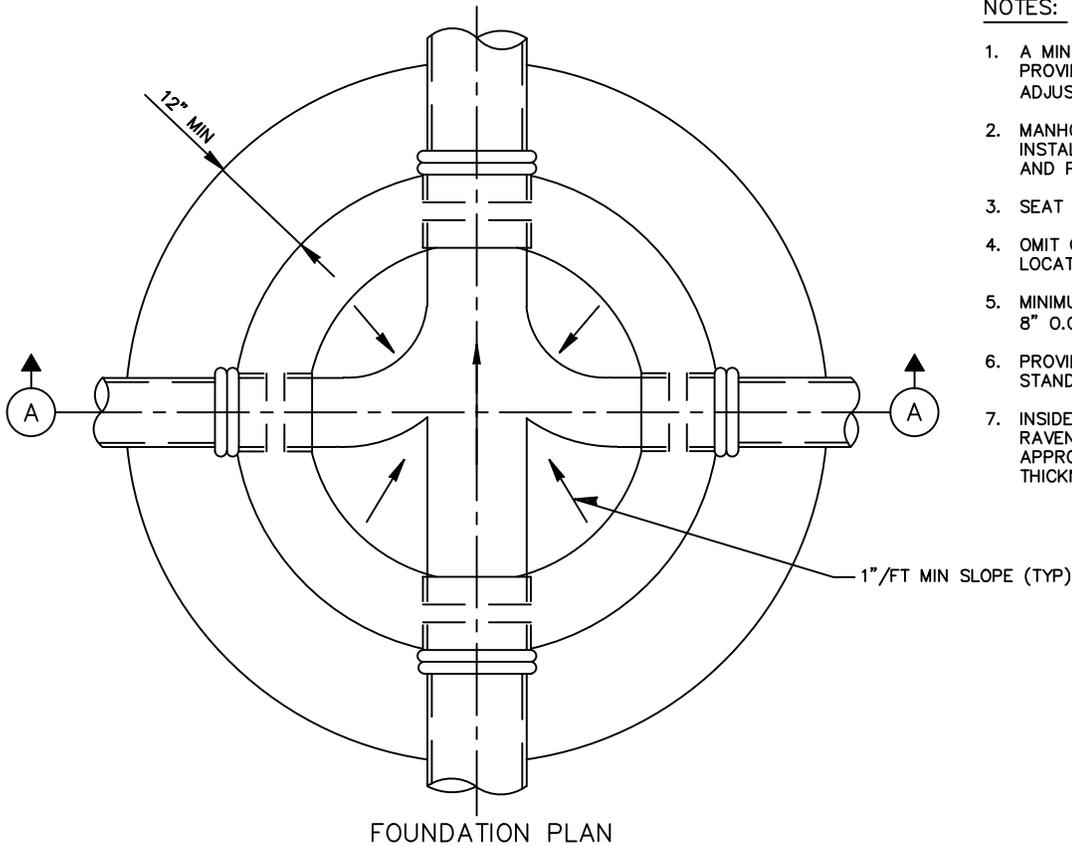

FOUNDATION PLAN

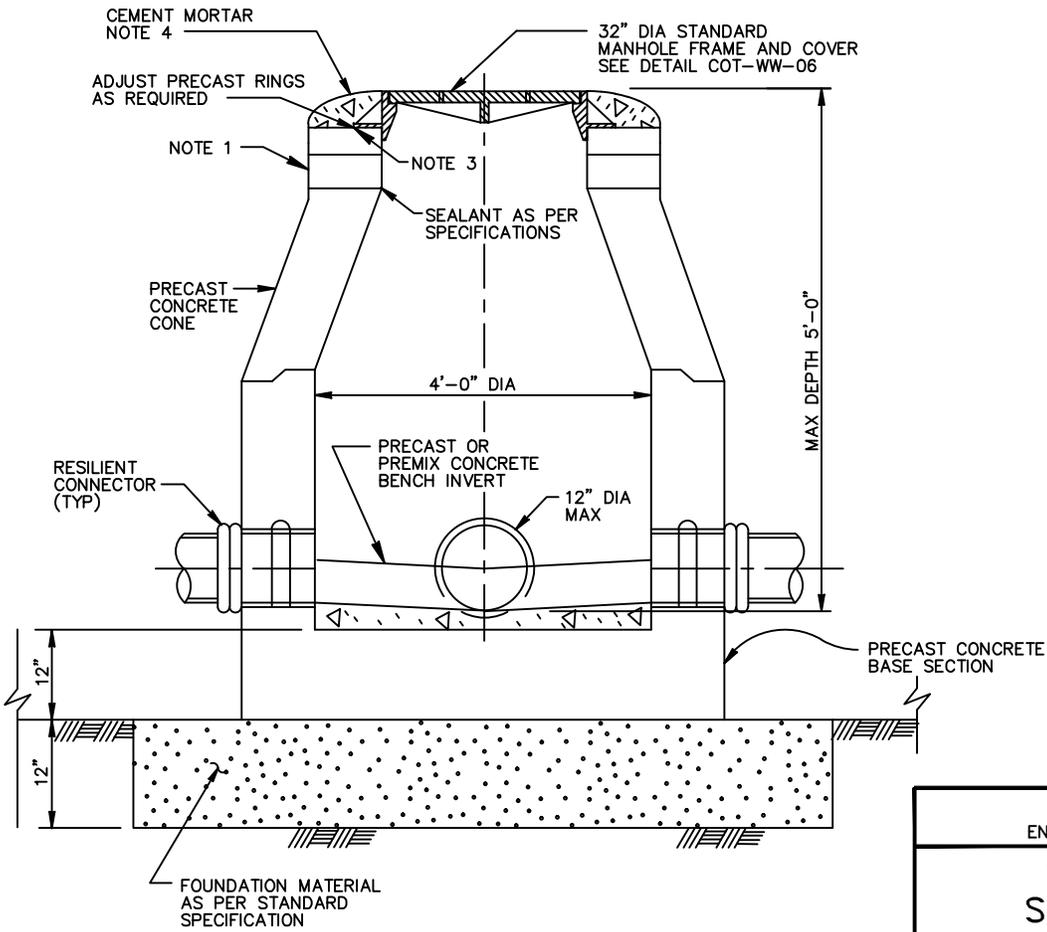

SECTION A

NOT TO SCALE

CITY OF TOMBALL
ENGINEERING & PLANNING DEPARTMENT

SANITARY SEWER
SHALLOW MANHOLE

APPROVED BY COT:

ENGINEERING & PLANNING DEPARTMENT
EFFECTIVE JULY 8, 2019