


PLAN VIEW

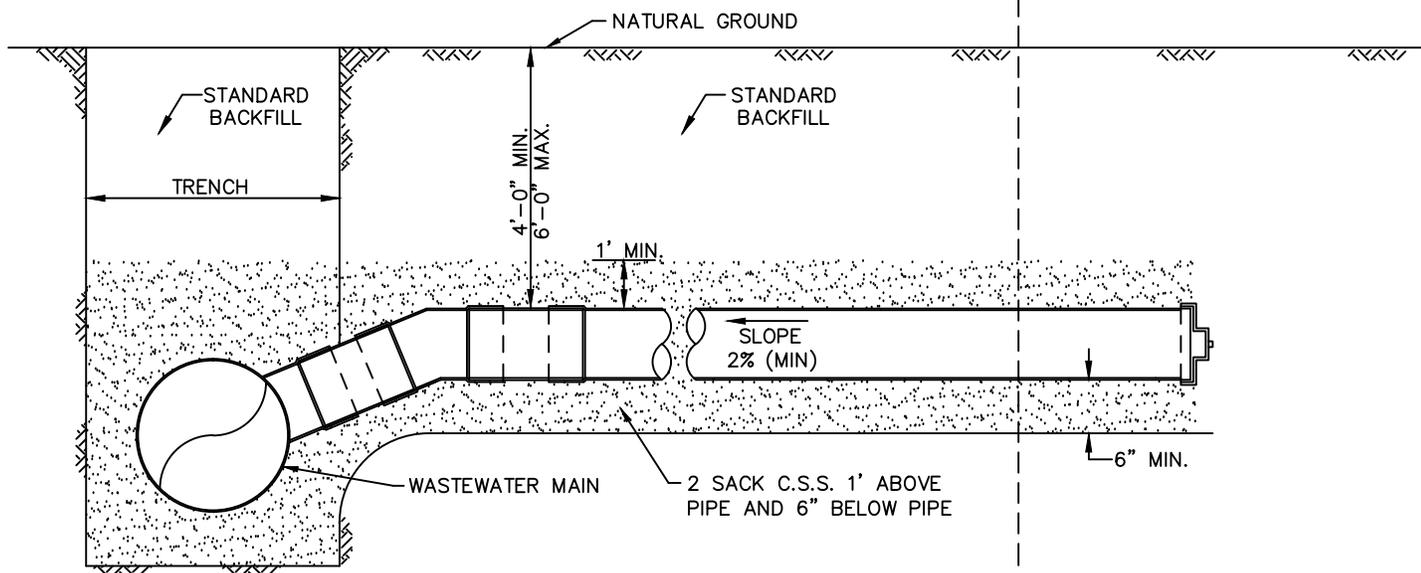

ELEVATION VIEW

NOTE:

- 1) STUBS OR LEADS SERVING TWO LOTS SHALL HAVE A SERVICE WYE WITH PLUGS.
- 2) ALL FAR-SIDE LEADS SHALL BE FOUR (4) INCHES OR SIX (6) INCHES AT 2.0% MIN. SLOPE.

NOT TO SCALE

CITY OF TOMBALL ENGINEERING & PLANNING DEPARTMENT	
WASTEWATER STANDARD SERVICE CONNECTION CONSTRUCTION DETAILS	
APPROVED BY COT:	
ENGINEERING & PLANNING DEPARTMENT EFFECTIVE JULY 8, 2019	
SHEET 001 OF 001	DWG NO: COT WW-16