


**NOTES:**

1. WHERE WET SAND IS ENCOUNTERED, REINFORCED CONCRETE PIPE SEWERS SHALL BE CONSTRUCTED USING APPROVED SPECIAL DESIGN AS SHOWN ON DRAWINGS.
2. MIN TRENCH WIDTH SHALL BE PIPE OD PLUS AN ALLOWANCE "A" FOR THE NOMINAL PIPE SIZE:

NOMINAL PIPE SIZE	"A"
18" TO 30"	24"
OVER 30"	36"

3. MAX TRENCH WIDTH SHALL NOT BE GREATER THAN MIN TRENCH WIDTH PLUS 24 INCHES, UNLESS OTHERWISE NOTED.
4. SELECT BACKFILL FOR RIGID PAVEMENT; FLEXIBLE BASE MATERIAL FOR ASPHALT PAVEMENT.

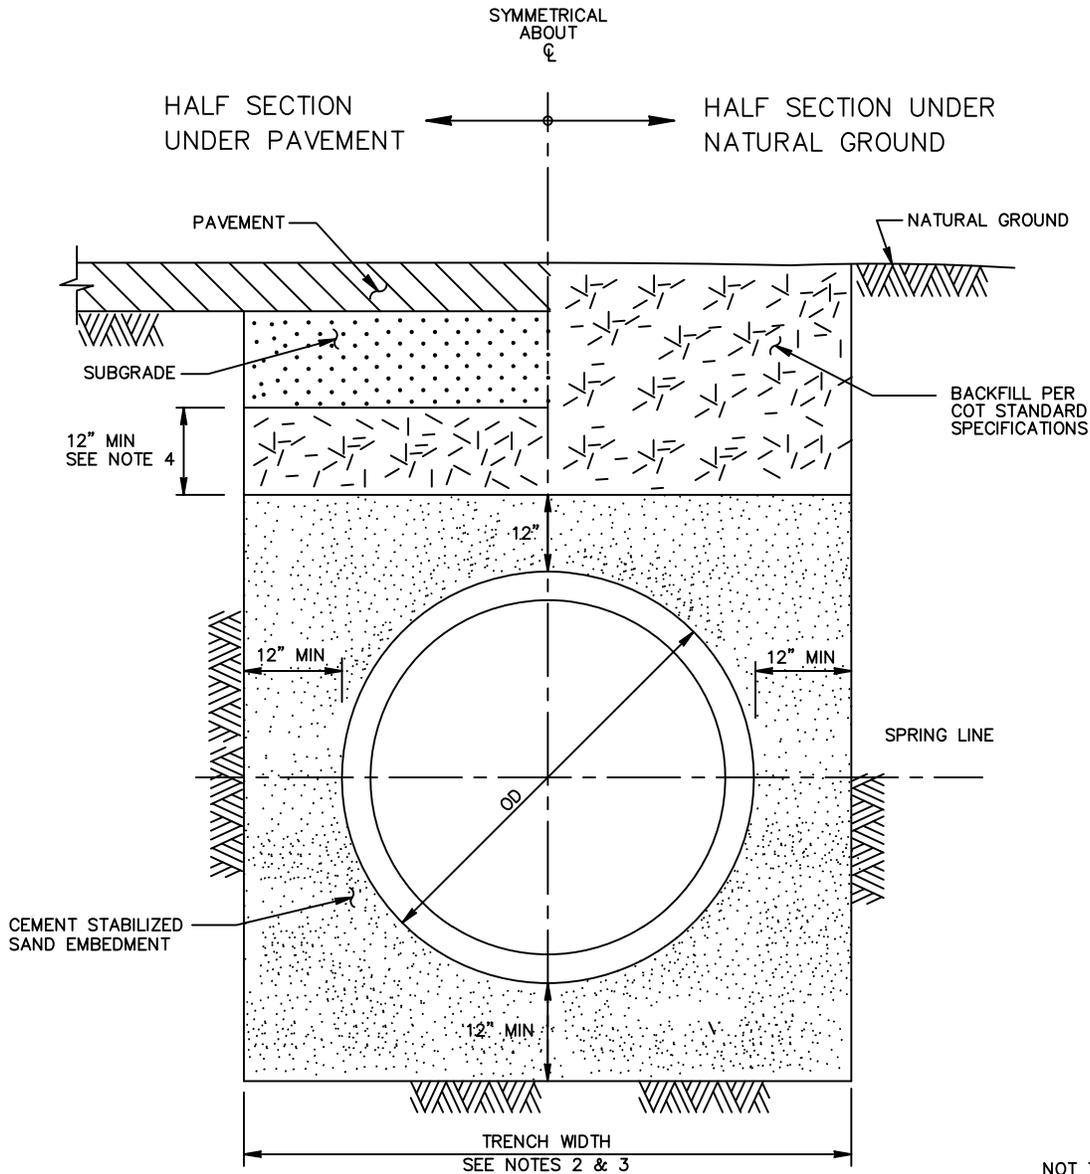

NOT TO SCALE

<b>CITY OF TOMBALL</b> ENGINEERING & PLANNING DEPARTMENT	
<b>SANITARY BEDDING &amp; BACKFILL FOR DRY STABLE TRENCH</b>	
APPROVED BY COT:	
ENGINEERING & PLANNING DEPARTMENT EFFECTIVE JULY 1, 2010	
SHEET 001 OF 001	DWG NO: COT WW-19