


# FIRE DEPARTMENT CONNECTION

FIRE DEPARTMENT CONNECTION SHALL BE LOCATED REMOTELY FROM STRUCTURE AND OUT OF THE COLLAPSE ZONE.

FDC'S SHALL HAVE A LOCKING KNOX CAP INSTALLED.

FDC'S SHALL BE 5" STORZ CONNECTION, EXCEPT FOR NFPA 13R AND NFPA 13D SYSTEMS, WHICH WILL HAVE A SINGLE 2½."

A SIGN SHALL BE PERMANENTLY AFFIXED TO THE FDC STATING THE ADDRESS IT SERVICES. (SEE FDC SIGN SPEC)

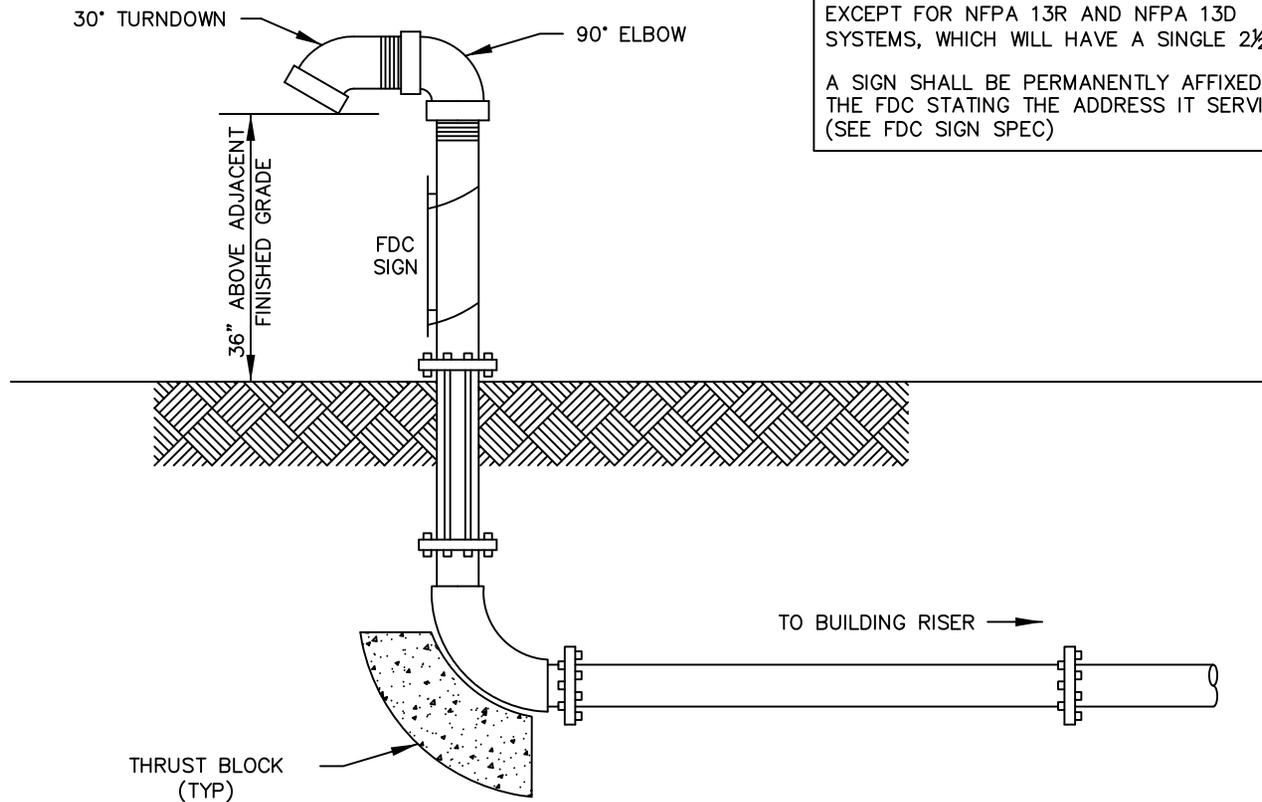

NOT TO SCALE

<b>CITY OF TOMBALL</b> DEPARTMENT OF ENGINEERING & PLANNING	
<b>FIRE DEPARTMENT CONNECTION</b>	
APPROVED BY:  DOUG SANGUEDOLCE FIRE MARSHAL	
SHEET 001 OF 001	DWG NO: COT FIRE-01