


FIRE DEPARTMENT CONNECTION (FDC) SIGN DESIGN REQUIREMENTS

1. SIGN SHALL BE CONSTRUCTED FROM A 15" HIGH BY 18" WIDE METAL SUBSTRATE NO THINNER THAN 0.063 INCHES.
2. SIGN SHALL HAVE SQUARE CORNERS.
3. BACKGROUND COLOR OF SIGN SHALL BE "FIRE ENGINE RED" NON-REFLECTIVE.
4. WHITE REFLECTIVE LETTERS SHALL BE USED AS SET OUT BELOW.
5. LETTER SHALL BE FONT COMPARABLE TO "FOLIO MEDIUM" OR "HELVETICA MEDIUM".
6. SIGN SHALL BE PERMANENTLY ATTACHED TO A WALL DIRECTLY ABOVE FIRE DEPARTMENT CONNECTION (FDC) OR BELOW FREESTANDING FDC. IT SHALL BE 72" FROM THE GROUND TO THE BOTTOM OF THE SIGN, UNLESS OTHERWISE APPROVED BY FIRE MARSHAL.
7. FIRST LINE (FDC) SHALL BE 6" HIGH LEFT WITH 3" BETWEEN EACH LETTER.
8. SECOND AND THIRD LINES SHALL BE 2" HIGH WITH 1/2" SPACING BETWEEN LETTERS.
9. THERE SHALL BE A 1.5" MARGIN COMPLETELY AROUND SIGN AND 1" SPACING BETWEEN LINES OF TEXT.
10. THERE SHALL BE 2" SPACING BETWEEN COMPLETE WORDS.
11. SECOND AND THIRD LINE SHALL HAVE ADDRESS OF BUILDING OR SUITE NUMBER THAT SYSTEM PROVIDES FOR.

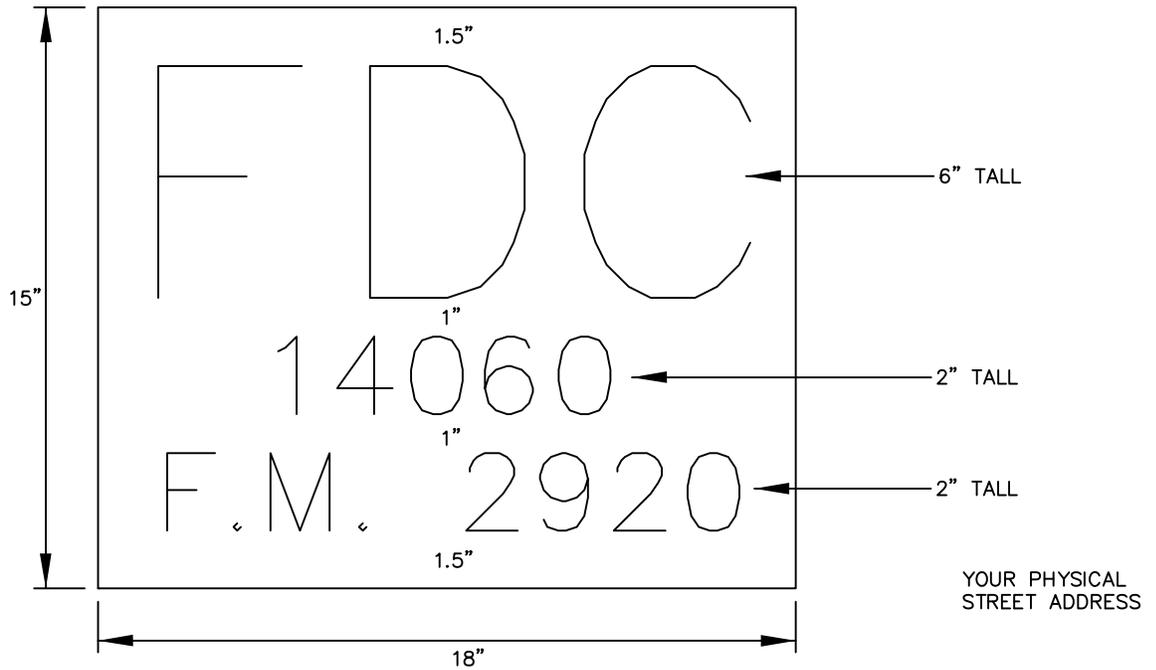

NOT TO SCALE

CITY OF TOMBALL ENGINEERING & PLANNING DEPARTMENT			
FDC SIGN DESIGN REQUIREMENTS			
APPROVED BY:			
<div style="border-bottom: 1px solid black; width: 100%; margin-bottom: 5px;"></div> DOUG SANGUEDOLCE FIRE MARSHAL			
SHEET	0010F	001	DWG NO: COT FIRE-02